
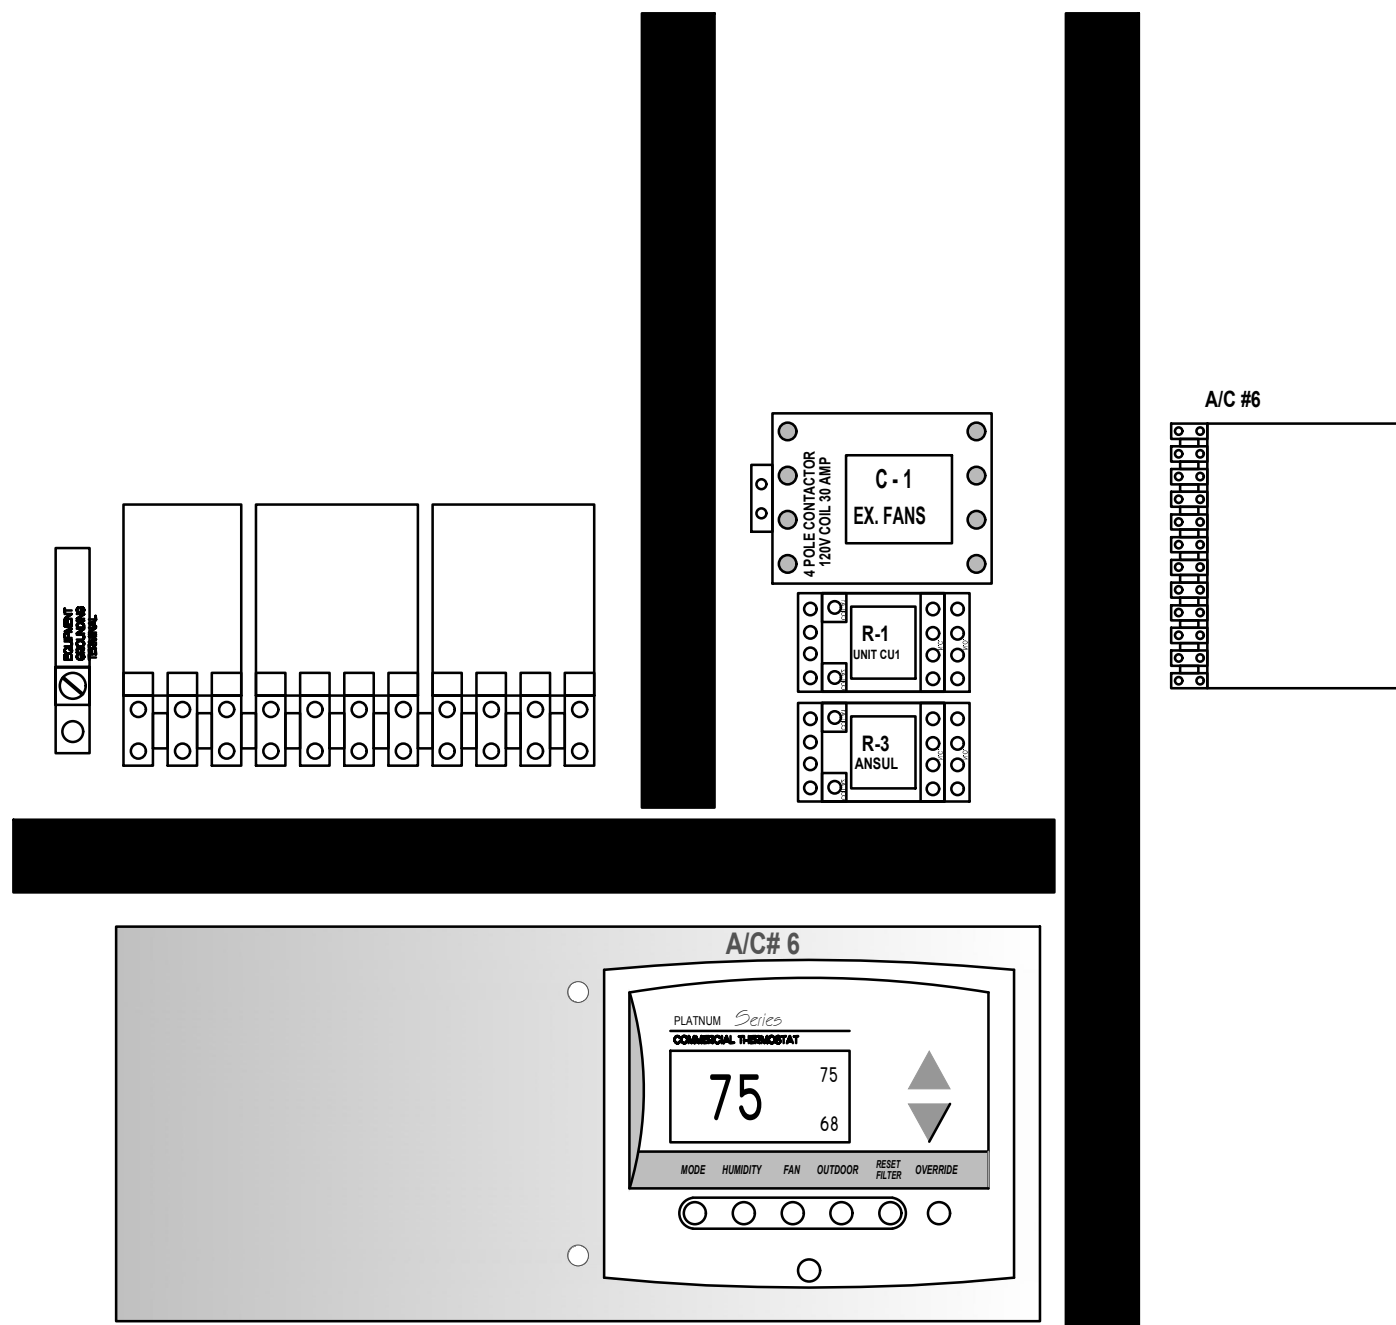


LENNOX UNIT
SUNCOAST ENVIRONMENTAL CONTROLS, INC.
DATE: 01-3-2011



FOR BID ONLY

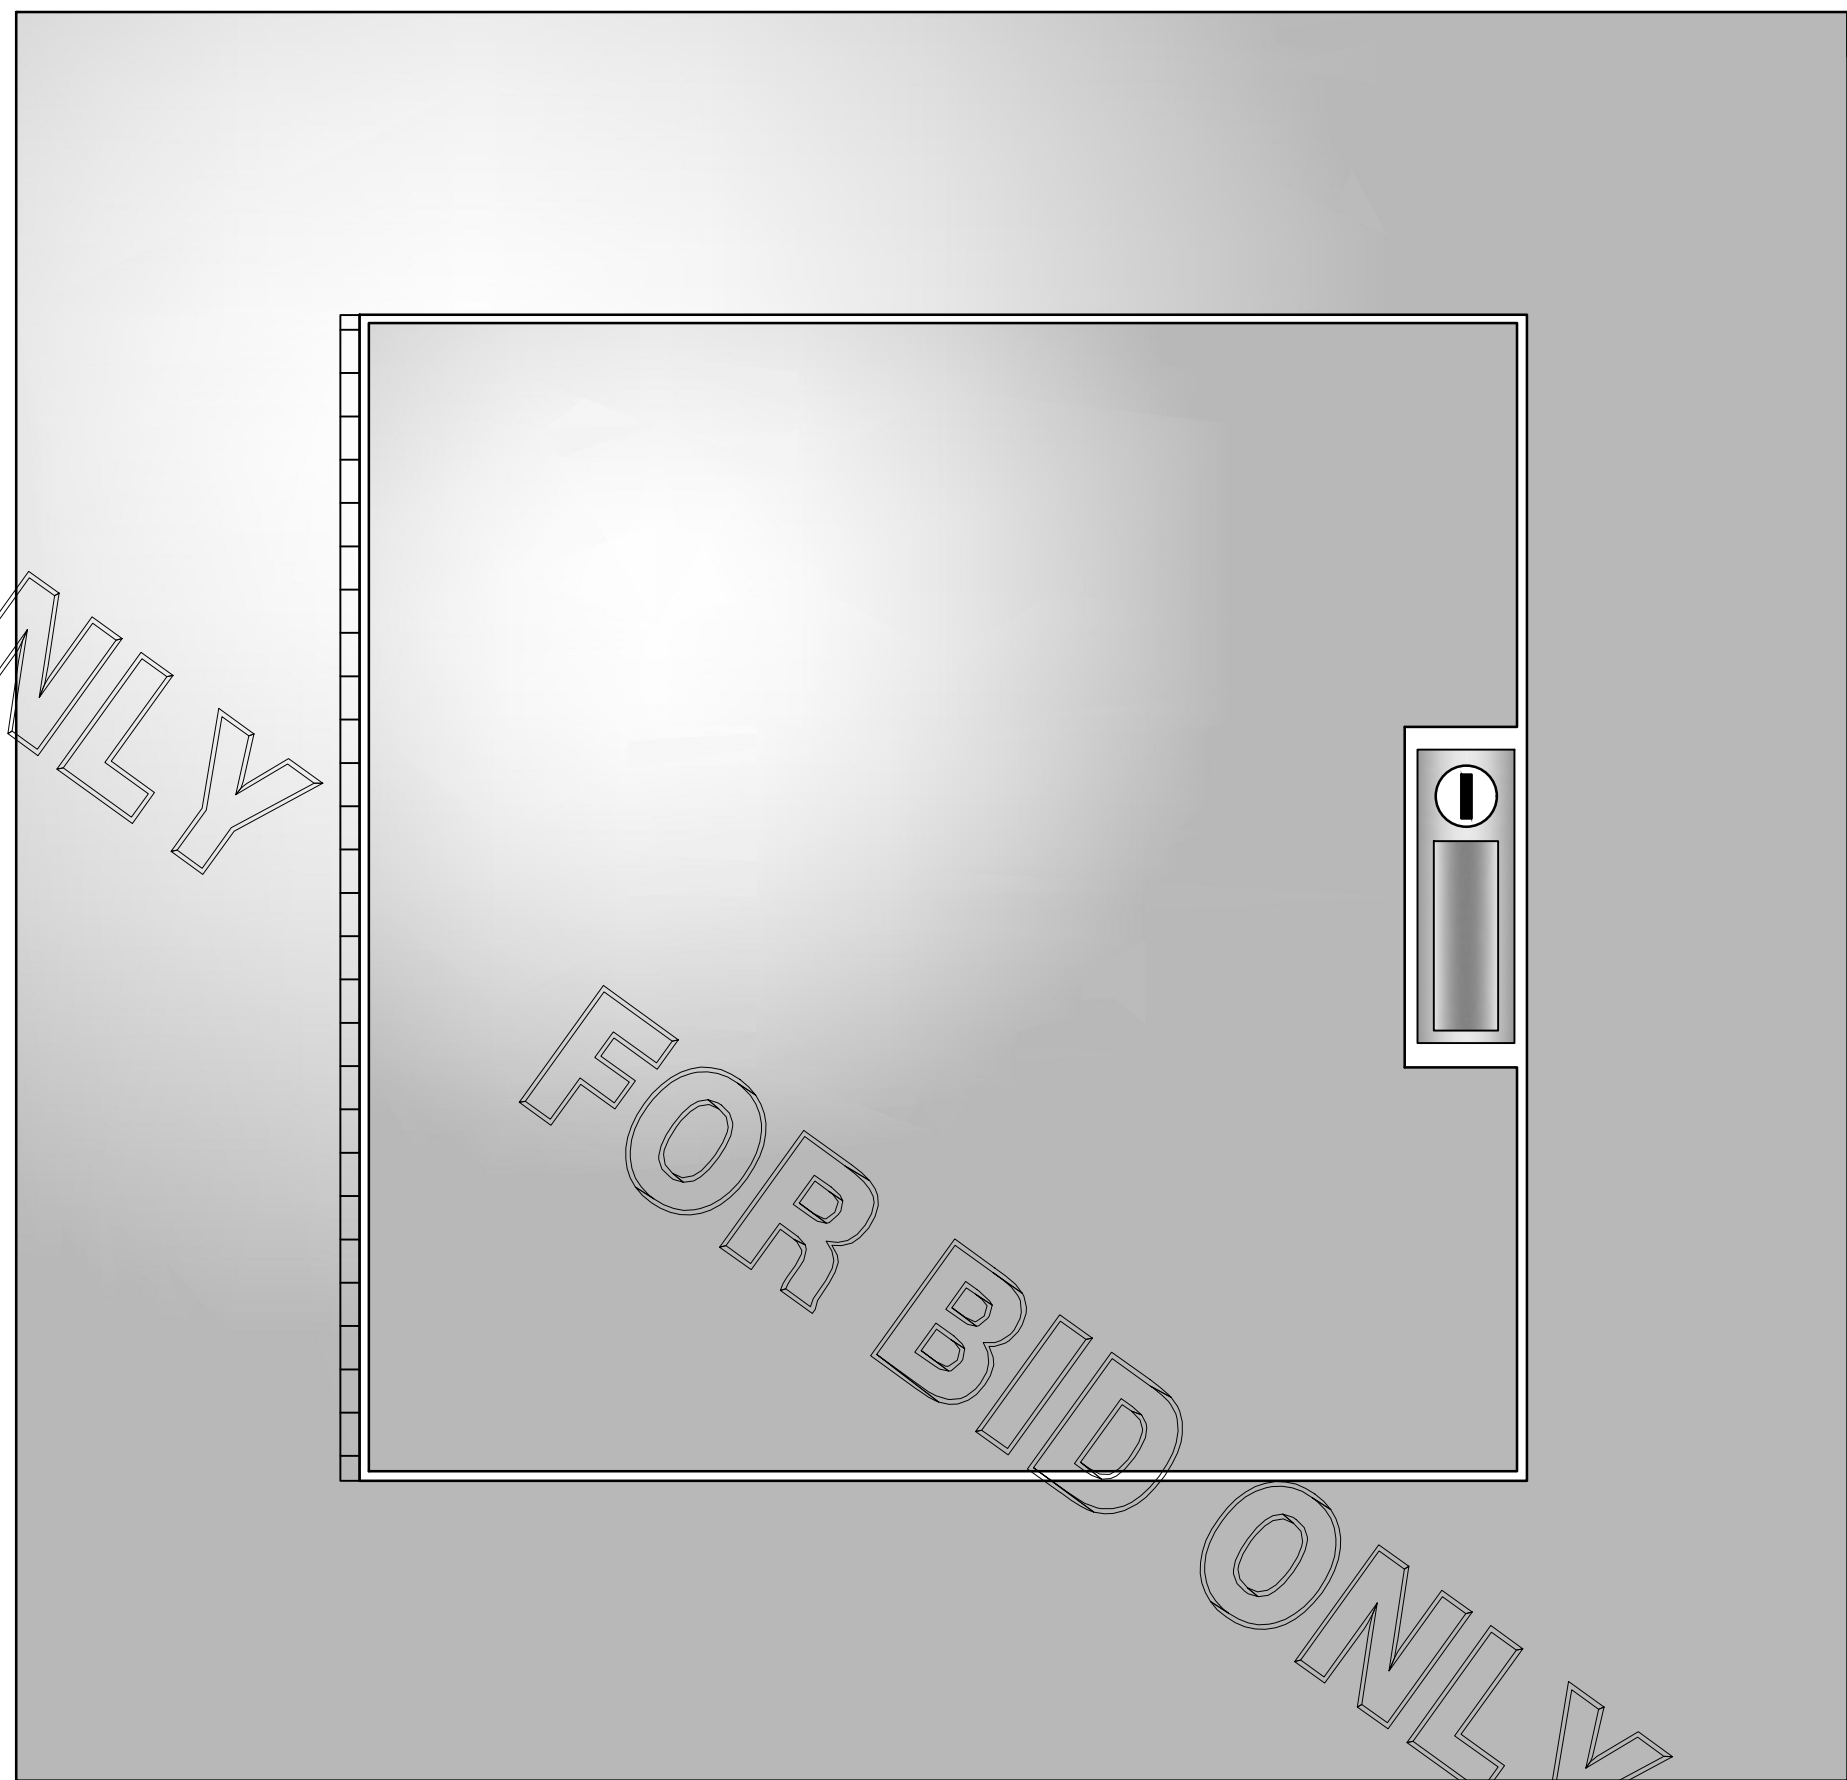

SUNCOAST PANEL

NONE


T500 PANEL TERM. BLOCKS | & II LADDER PANEL TERM. BLOCK

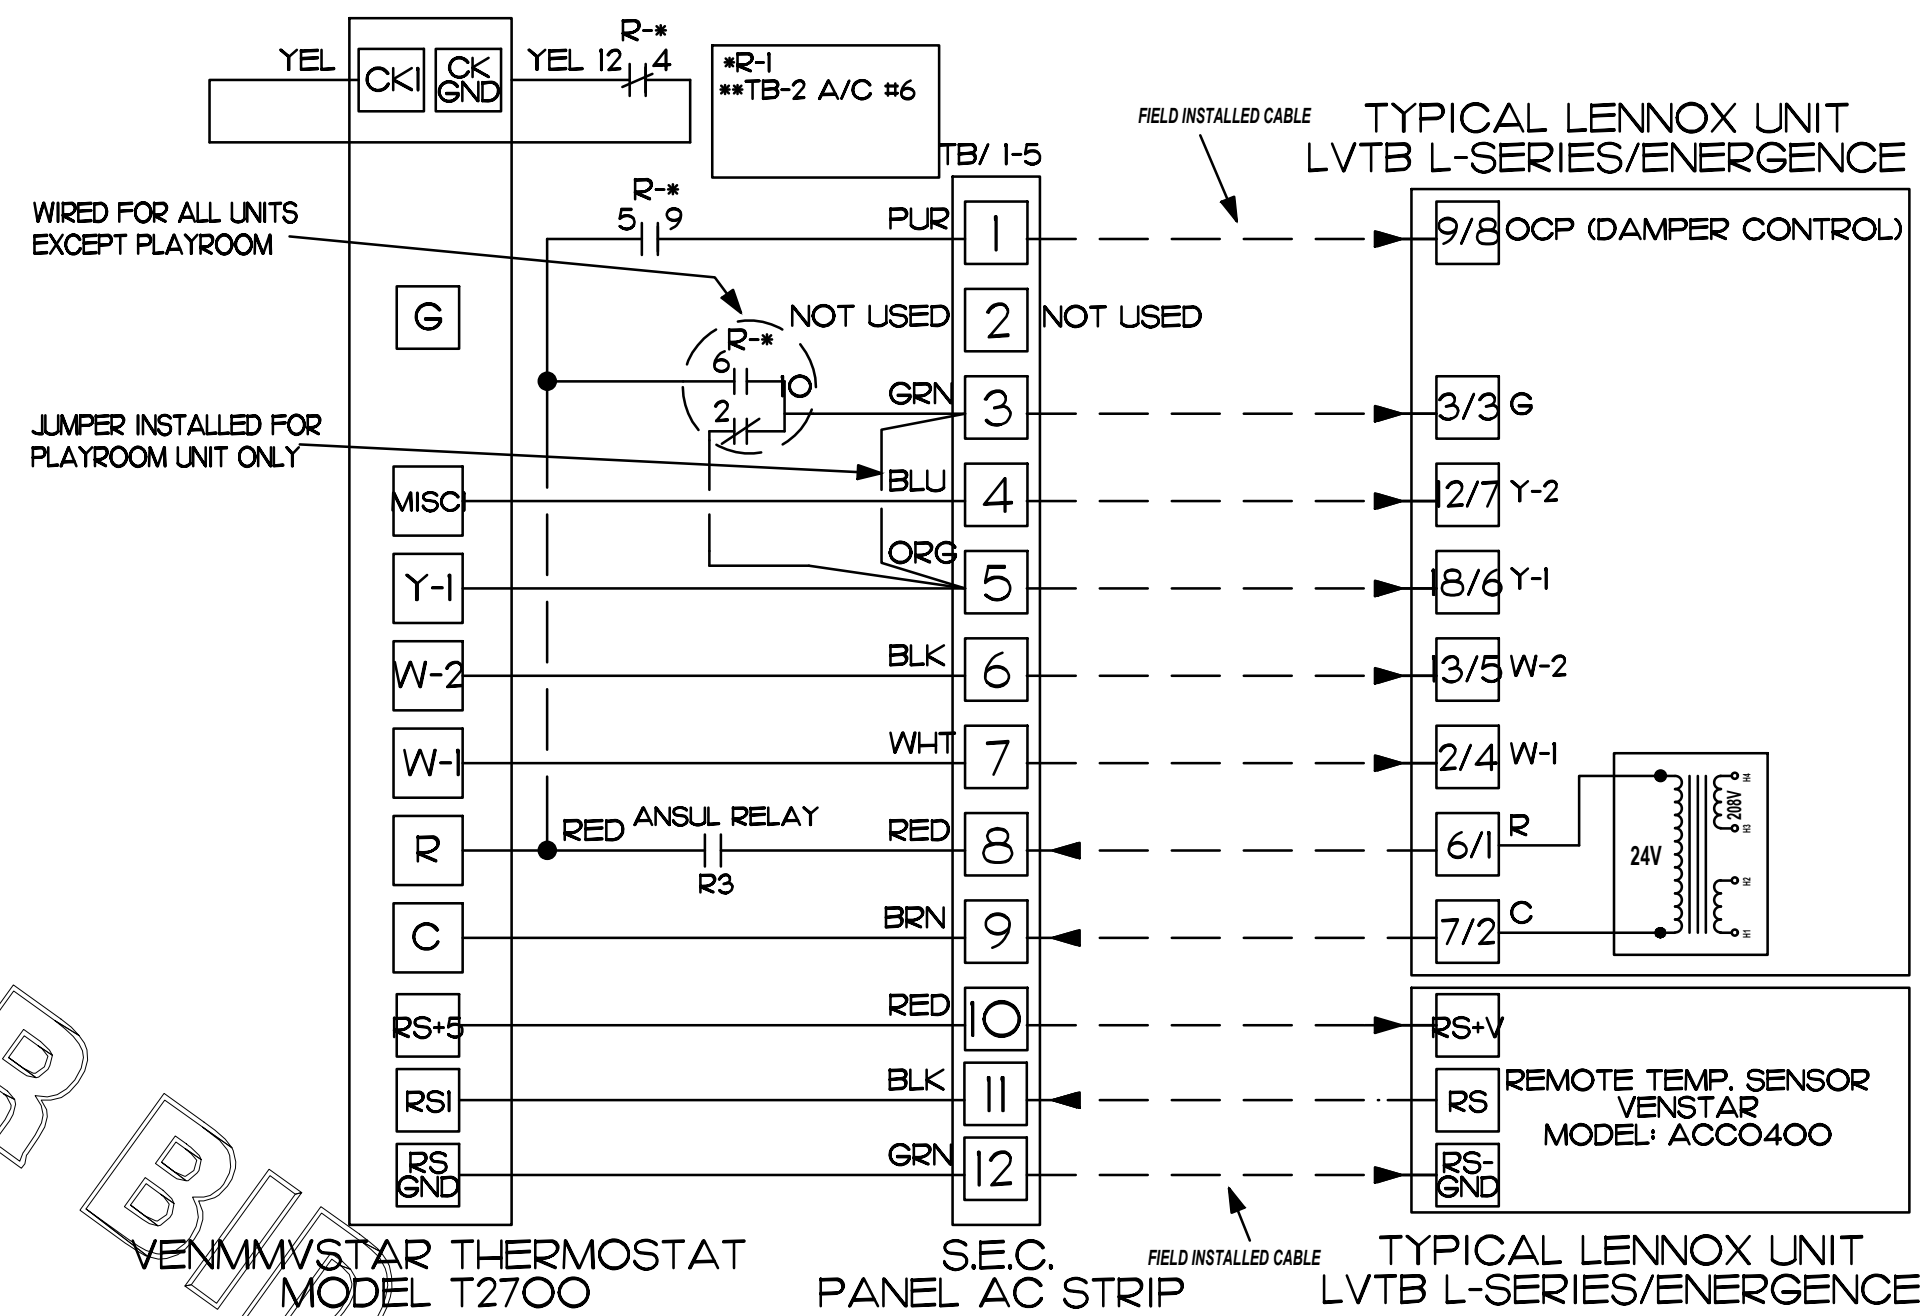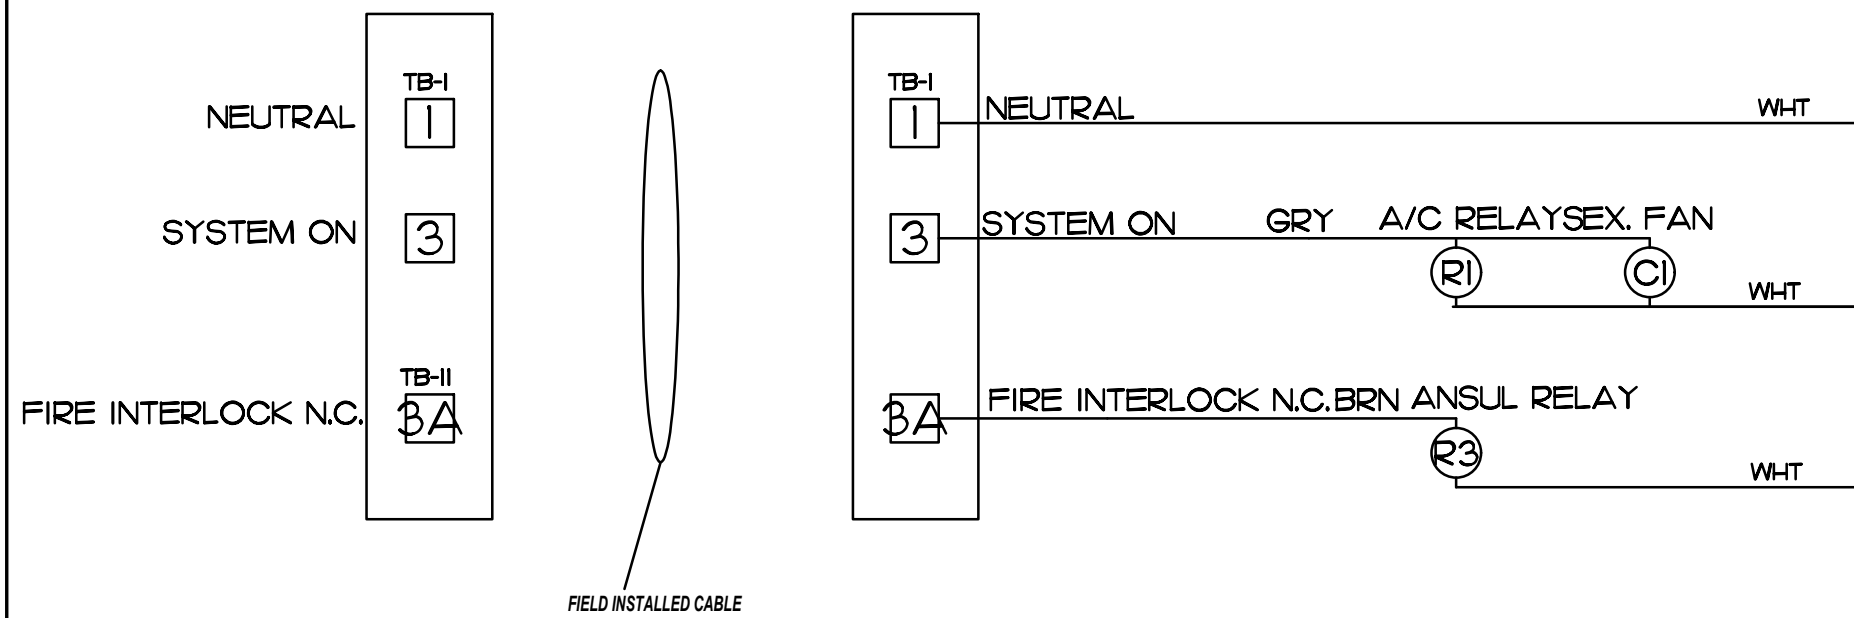

LENNOX UNIT

SEC
SUNCOAST ENVIRONMENTAL
CONTROLS, INC.

CHICK-FIL-A HVAC "ADD-ON" PANEL
MULTI A/C UNIT LADDER DIAGRAM
DATE: 01-3-2011

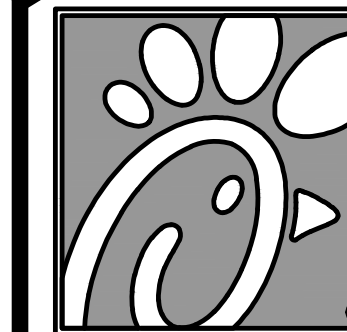

Chick-fil-A

5200 Buffington Rd.
Atlanta Georgia,
30349-2998

Revisions:

Mark Date By

△

△

△

△

SEAL

THIS DOCUMENT IS "NOT FOR CONSTRUCTION"
UNLESS THE ARCHITECT OR ENGINEER'S
SIGNATURE AND SEAL APPEAR BELOW.

STACY HENSON, P.E.

INTERPLAN

ARCHITECTURE
ENGINEERING
INTERIOR DESIGN
PROJECT MANAGEMENT

604 COURTLAND STREET
SUITE 100
ORLANDO, FLORIDA 32804
PH 407.645.5008
FX 407.629.9124

STORE

S97-100
Jimmy Carter Blvd
FSU #0745

5455 Jimmy Carter Blvd
GA, 30093-1512

SHEET TITLE
HVAC CONTROLS

VERSION: V7.025
ISSUE DATE: 01-2017

Job No. : 17.0522

Store : 0745

Date : 10.09.17

Drawn By : DG

Checked By: JL

Sheet

M-4.3

COPYRIGHT © 2017 INTERPLAN LLC. ALL RIGHTS RESERVED. NO PART OF THIS DOCUMENT MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM INTERPLAN LLC.