


NO	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED				
				LOCATION	QUANTITY		TYPE	#	HP	VOLT	FLA
1		SC-321110FP-SEP	WALL UTILITY CABINET LEFT	08 - SHIP LOOSE W/ PREWIRE	1 LIGHT 1 FAN	SMART CONTROLS THERMOSTATIC CONTROL	EXHAUST	3	2,000	208	5.9
							EXHAUST	3	2,000	208	5.9
							SUPPLY	3	5,000	208	15.0

HOOD SHALL BE INSTALLED WITH MINIMUM 3 FEET CLEARANCE FROM FACE OF ELECTRICAL CONTROL PANEL AS REQUIRED BY NATIONAL ELECTRICAL CODE SECTION 110-26

JOB NO 4848007	MODEL NUMBER SC-321110FP-SEP	DRAWN BY	SCHEMATIC TYPE INSTALL	DESCRIPTION OF OPERATION: 3 Phase w/ control for 2 Exhaust Fans, 1 Supply Fan, Exhaust on in Fire, Lights out in Fire, Fan(s) On/Off Thermostatically Controlled. Separate Breaker Input for each Fan. Room temperature sensor shipped loose for field installation. INVERTER DUTY 3 PHASE MOTOR REQUIRED FOR USE WITH VFD.
JOB NAME Panda Express - Westfield IN ...		DATE 4/16/2021	DWG NO ECP #1-1	

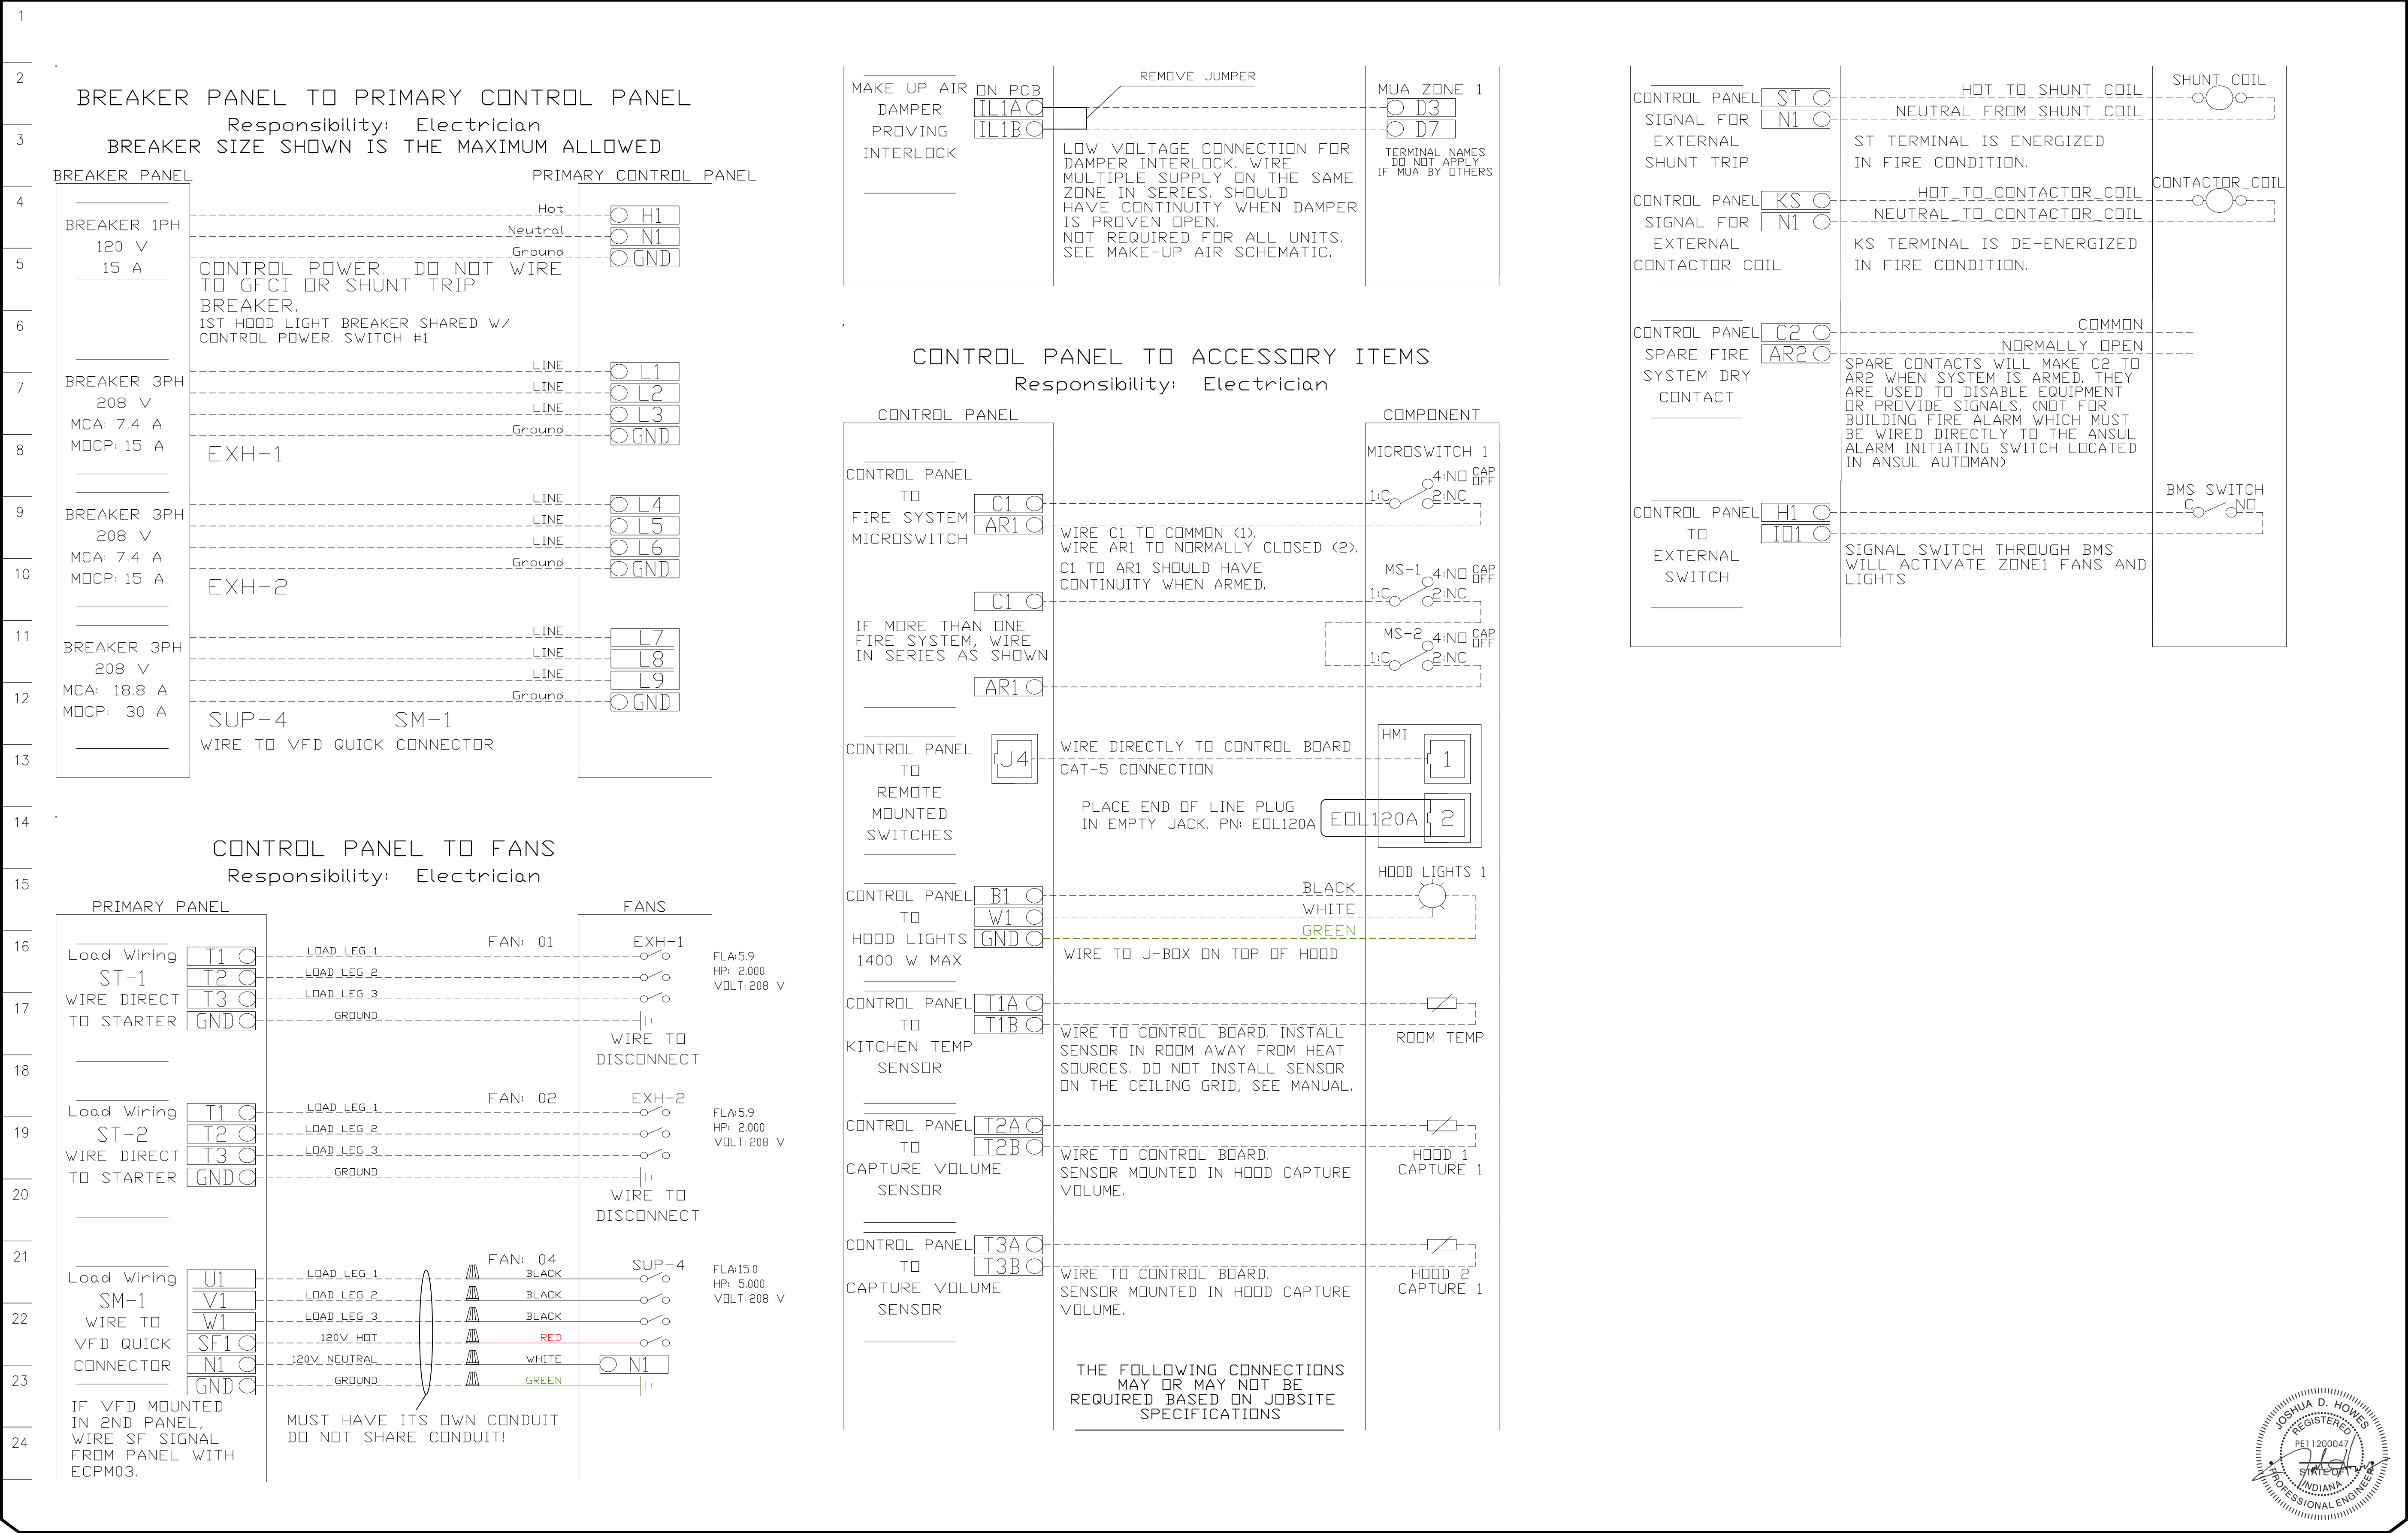

REVISIONS

DESCRIPTION	DATE:
△	
△	
△	
△	



www.captiveaire.com

Southern California Office

3002 Dow Ave., Suite 410, Tustin, CA, 92780 PHONE: (714) 957-1500 FAX: (919) 227-5975 EMAIL: reg@capitveaire.com

Panda Express - Westfield IN (D8060)

390 W Spring Mill Pointe Dr,
Westfield, IN, 46074

DATE: 5/21/2021

DWG.#:
4848007

DRAWN BY: AH-86

SCALE:
NO SCALE

MASTER DRAWING



SHEET NO.
8